


NOTE:  
 ALL NIPPLES, FITTINGS  
 AND CONNECTIONS OF  
 THE SERVICE PIPING A  
 METER SETTING SHALL  
 BE BRASS OR COPPER.  
 SOLDER JOINTS PRO-  
 HIBITED ON ALL UNDER-  
 GROUND WATER SERVICE  
 PIPING.

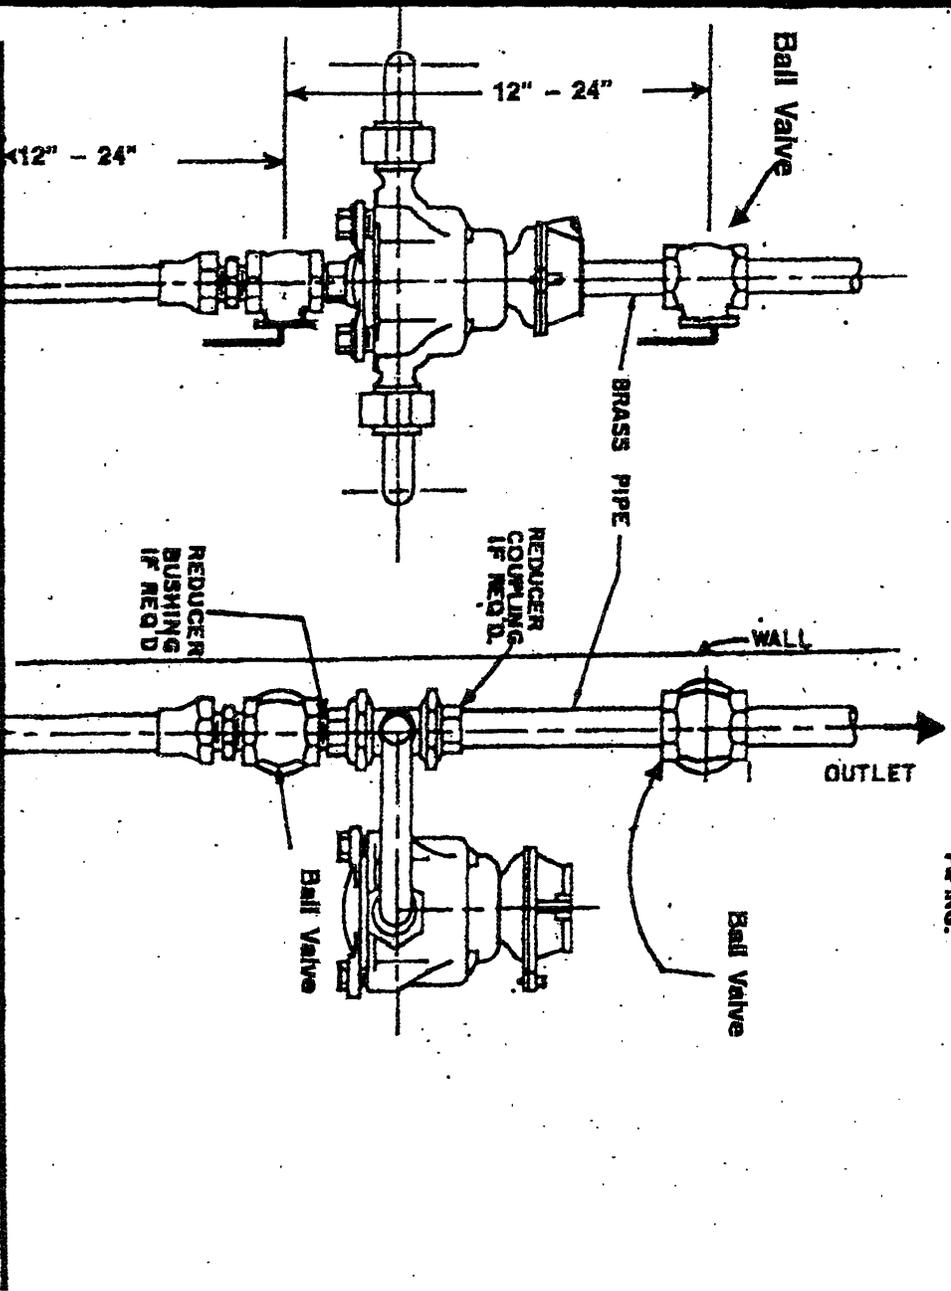

**Residential Meters**  
**Badger #25 - 1" x 7 1/2"**  
**Badger #40 - 1 1/4" x 10 3/4"**

**WATER UTILITY METER  
 SET REQUIREMENTS**

FRANKLIN  
 ENGINEERING DEPT.

DRAWN BY \_\_\_\_\_  
 APPROVED BY \_\_\_\_\_  
 NOT TO SCALE

Figure No. 25